



## COMPANY SUMMARY



# QUALITY AND SAFETY MANAGEMENT SYSTEM

**June 2026**

---

**INDEX**

## Document Pages

- Page 01.....Index
- Page 02.....Company Summary
- Page 03.....Company Profile
- Page 04.....Company Management Structure
- Page 05.....OEM Support
- Page 06.....CASA CAR 30
- Page 10.....SAI Global Certificate of Conformity
- page 11.....SAI Global Certificate of Conformity cont.
- Page 12.....Dept of Defence Recognised Supplier
- Page 13.....Dept of Defence NATO NCAGE
- Page 14.....Fire Protection Association FPAS Scheme
- Page 15.....SAMFS Recognised Contractor
- Page 16.....JOSCAR-AU Company Qualifications
- Page 17.....Test Station Certificate
- Page 18.....Test Station Quality Assurance Data Log Certificate
- Page 19.....Extinguisher Agent Trading Authorisation
- Page 20.....Blank Page

**QUALITY & SAFETY MANAGEMENT  
SYSTEM & COMPANY SUMMARY**

100 SOUTH TERRACE  
WINGFIELD S.A 5013

PHONE:1300 88 3473  
EMAIL: info@firesys.com.au

**FSS CONTACTS**

	<b>OPERATIONS</b>	<b>QUALITY</b>	<b>ACCOUNTS</b>
Name	Nick Papamichael	Joel Papamichael	Accounts
Title	General Manager Operations	Quality Manager	Accounts Payable & Receivable
Direct Phone	(08) 8445 6300	(08) 8445 6300	(08) 8445 6300
Direct E-Mail	nick@firesys.com.au	joel@firesys.com.au	admin@firesys.com.au

**INSUARANCE & WORKCOVER**

	<b>Organisation</b>	<b>Issue Date</b>	<b>Policy Number</b>
Certificate of Currancy	FPII	29-April-2022	FPII 13483
Professional Idenity	FPII	29-April-2022	FPII 13483
Work Cover	Return to Work SA	12-July-2022	21491711

**QUALITY ACCREDITATION, APPROVALS AND GOVERNMENT CERTIFICATIONS**

QUALITY SYSTEM SCOPE:				
<i>The service, repair, refurbishment and overhaul of fire safety equipment &amp; aircraft components.</i>				
<b>Certification Type</b>	<b>Certifying Organisation</b>	<b>Certification Issue Date</b>	<b>Registration Number</b>	<b>Last Audit</b>
CAR 30	CASA	05-Dec-2024	CASACOA0803	Dec-2025
AS2337	SAI Global	03-Mar-2008	GCT20720	Aug-2025
DRSS	Dept of Defence	27-Oct-2007		N/A
NCAGE	NATO Dept of Defence	17-Dec-2007	Z0CU0	N/A
FPAS	FPA Fire Protection Ass	00-June-2020	IT24585	N/A
EATA	FPIB Fire Protection Ind	06-Aug-2024	EATA15409	Aug-2027

Copies of all pertinent certificates are available from Company web site:  
<https://firesys.com.au/licenses-accreditations-ohws/>

**SHIPPING & PAYMENT DETAILS**

<b>SHIPPING &amp; POSTAL ADDRESS</b>	<b>PAYMENT TERMS &amp; INSTRUCTIONS</b>
100 SOUTH TERRACE, WINGFIELD SA 5013 ADELAIDE - AUSTRALIA	Bank: National Australia Bank Branch: Adelaide Account Name: Fire System Services BSB No: 085 005 Account No: 561 558 143 Payment Terms – 14 Days EOM

Approved by:



.....  
Signature

Nick Papamichael  
Accountable Manager  
for and behalf of Fire System Services

## **COMPANY PROFILE**

FSS Fire System Services SA Pty Ltd is an Privately Owned Australian Company.

The Company Intellectual Property consists of three divisions (Fire System Services , National Hydro Cylinder Testing Services , Aviation Fire Systems Australia) assists the company to work in a vast array of the market for private & commercial needs as well as state & federal government needs.

FSS Group of companies combines more than 35 years of safety expertise with state-of-the-art technology and a highly skilled workforce to give customers confidence in their systems.

### **Fire System Services - Essential Safety Provision Testing**

Fire System Services provides servicing of Buildings Essential Safety Provisions. An important provision in Australian Standard AS1851 Routine Service of Fire Protection Systems and Equipment is the need to keep records of the service work carried out as evidence that the systems and equipment are fit to fulfill the intended purpose. Fire System Services uses an asset management software program called FireMate.

Services include: Fire Fighting Equipment, Fire Alarm & Occupant Warning Systems, Fire Sprinkler Systems Exit & Emergency Evacuation Lighting, Electrical Safety Maintenance.

### **National Hydro Cylinder Testing Services - Hydrostatic & NDT Testing**

National Hydro Cylinder Testing Services operates and manages an approved and licensed cylinder test station GCT 720 audited by SAI Global.

National Hydro Cylinder Testing Services has the capability to hydrostatically test to various pressures. We can test to as low as 1.0 MPA or as high as 100 MPA, with either a Proof Test or a Volumetric Expansion Test.


The station is certified to test the following: Automotive LPG, Composite, Seamless, Welded and Brazed Cylinders.

### **Aviation Fire Systems Australia - Aircraft Aviation Services**

Aviation Fire Systems Australia provides sustainment in the field of aircraft maintenance aviation services involving testing and releasing various aircraft pressurised bottles. Workshop services can range from testing aircraft fire safety cylinders, oxygen life support cylinders, inflation cylinders to structural testing of aviation hydraulic pressure lines.

Every commercial/business aircraft has many pressurised vessels on board. These include oxygen bottles, portable fire extinguishers, emergency air bottles, and engine and APU fire extinguishers. All must be inspected and tested at specific intervals to ensure container strength and integrity.

## FSS Company Management Structure

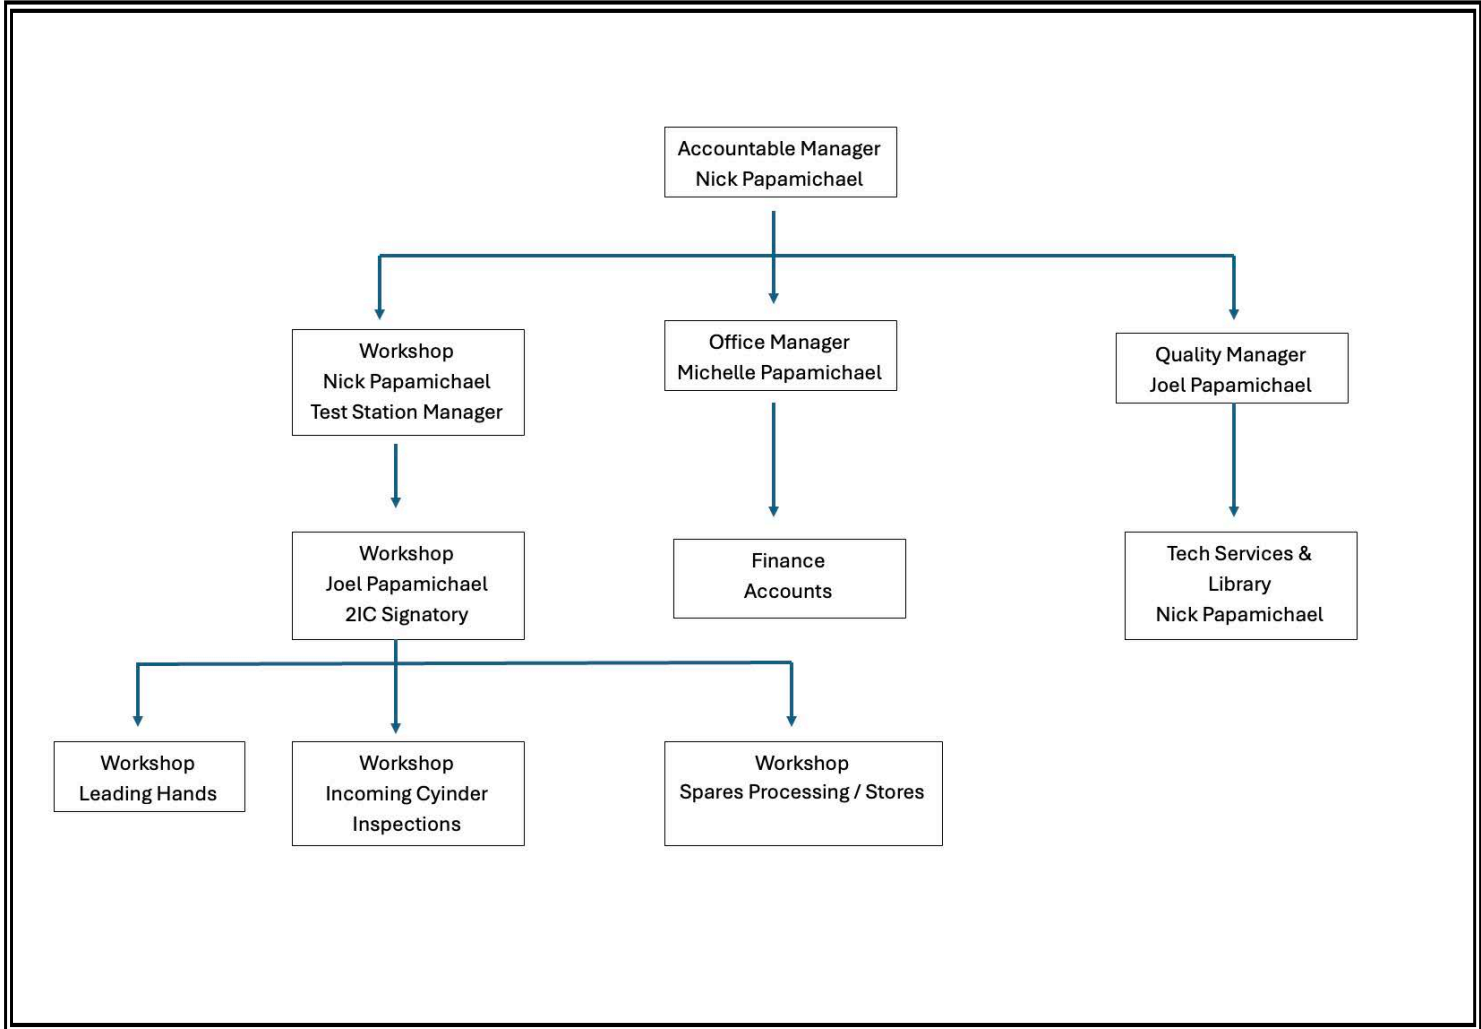

## OEM Support

FSS is an Recognised Service and Repair Centre for

- **Aerospace Cylinders**
- **Aviation Fire Extinguishers**
- **Breathable Air Cylinders**
- **Exit & Emergency Evacuation Lighting**
- **Fire Alarm Detection & Occupant Warning Systems**
- **Fire Fighting Equipment**
- **Fire Sprinkler Systems**
- **General Hand Held Fire Extinguishers**
- **Life Raft Inflation Cylinders**
- **Lithium Battery Fire Fighting Equipment**
- **Oxygen Equipment**

**CASA CAR 30 Certificate**

**Issue: 3 Expiry Date: n/a**

CIVIL AVIATION SAFETY AUTHORITY CIVIL AVIATION SAFETY AUTHORITY CIVIL AVIATION SAFETY AUTHORITY CIVIL AVIATION SAFETY AUTHORITY

 **Australian Government**  
**Civil Aviation Safety Authority**

**CIVIL AVIATION REGULATIONS 1988**

**CERTIFICATE OF APPROVAL**

Reference Number: CASA.COA.0803 Revision: 2

This Certificate of Approval (COA) is granted to:

**FSS FIRE SYSTEM SERVICES SA PTY LTD**

ARN: 1045431 ACN: 113 794 924

Address: 100 South Terrace, Wingfield, SA 5013

This Certificate of Approval having been granted pursuant to regulation 30 of the Civil Aviation Regulations 1988, provides authority for the holder to carry out the aviation related activities at the locations listed in Schedule 1 subject to conditions listed in Schedule 2.

This certificate is effective from 05 December 2024.



Hugh Chisholm Clark  
Manager Regulatory Services  
Regulatory Oversight Division

Delegate of the Civil Aviation Safety Authority

5 December 2024

CIVIL AVIATION SAFETY AUTHORITY CIVIL AVIATION SAFETY AUTHORITY CIVIL AVIATION SAFETY AUTHORITY CIVIL AVIATION SAFETY AUTHORITY

**CASA CAR 30 Certificate**

**Issue: 3 Expiry Date: n/a**

**Schedule 1 to Certificate of Approval**

Reference Number: CASA.COA.0803 Revision: 2

The following approved activities may be conducted at:

**TYPE: MAIN**

**LOCATION: 100 SOUTH TERRACE, WINGFIELD, SA 5103, AUSTRALIA**

**1. Maintenance of aircraft airframe components, engines and engine components**

(a) Aircraft Pressure Vessels

(i) Compressed Air Gas Cylinders (aluminum seamless construction)

**Limitations:** Inspection, testing and valve replacement of cylinders

(ii) Helium Gas Cylinders (aluminum seamless construction)

**Limitations:** Inspection, testing and valve replacement of cylinders

(iii) Nitrogen Gas Cylinders (aluminum seamless construction).

**Limitations:** Inspection, testing and valve replacement of cylinders.

(b) Emergency equipment

(i) Portable Oxygen cylinders (composite construction)

**Limitations:** Inspection, testing and valve replacement of cylinders

(ii) Portable fire extinguisher cylinders (aluminium seamless construction)

**Limitations:** Inspection, testing and refilling of Halatron and CO2 cylinders

**2. Maintenance of hot air balloon components**

(a) Fuel tanks

(i) Liquefied Petroleum Gas Cylinders (welded stainless-steel construction)

**Limitations:** Inspection, testing and valve replacement of cylinders.

===== END THIS LOCATION =====

===== END OF SCHEDULE 1 =====

**CASA CAR 30 Certificate**

**Issue: 3 Expiry Date: n/a**

**Schedule 2 to Certificate of Approval**

Reference Number: CASA.COA.0803 Revision: 2

Approved activities set out in Schedule 1 are subject to the following conditions:

1. The Reference Number must be used when the Civil Aviation Regulations 1988, the Civil Aviation Safety Regulations 1998, or an instrument made under any of these regulations requires a CASA reference number to be included in a Form or other document, for the purpose of the regulations or the instrument.

===== END OF SCHEDULE 2 =====

**CASA CAR 30 Certificate**

**Issue: 3 Expiry Date: n/a**



**Australian Government**  
**Civil Aviation Safety Authority**

21 December 2023

FSS FIRE SYSTEM SERVICES SA PTY LTD  
PO Box 16  
PROSPECT SA 5082

Email: [nick@firesys.com.au](mailto:nick@firesys.com.au)

Dear Sir / Madam

**RE: Certificate of Approval (COA): CASA.COA.0803 Revision Initial**

I refer to your application for a Certificate of Approval (COA) dated 29 September 2022. The enclosed certificate and the associated schedules have been granted pursuant to sub-regulation 30(2A) of the Civil Aviation Regulations.

Please review your certificate and ensure all information is correct. If any information needs to be changed or you have any questions relating to this document, please e-mail CASA at [regservices@casa.gov.au](mailto:regservices@casa.gov.au) or call 131 757.

Reconciliation of your account has been finalised and there are no adjustments to be made to the initial estimated costs that you have already paid.

If you should require additional information or guidance on any of the above matters, please contact CASA on 131 757.

Yours faithfully



Jonathan Kapper  
Regulatory Services Officer  
Regulatory Oversight Division

Enc: COA Certificate

**AS2337 Cylinder Test Station Certificate**

**Expiry Date: 02 March 2028**



# CERTIFICATE OF CONFORMITY

**SAI Global hereby grants:**

**Fire System Services  
Aviation Fire System Australia  
National Hydro Cylinder Testing Services**

ABN 47 635 264 476

100 South Terrace, Wingfield, SA 5013, Australia

as a Test Station for the Inspection and Testing of Gas Cylinders or Vessels as defined in Australian Standard 2337 or other relevant Standard as specified on this Certificate. All cylinders or vessels passed for service shall be stamped with the Test Station Mark and the test date. Test Certificates issued by the Certified Test Station shall be valid only when signed by one of the Nominated Signatories. This certificate of Conformity is issued subject to SAI Global Pty Limited Terms and Conditions for certification services.

<b>Issued:</b> 8 February 2023	<b>Originally Certified:</b> 3 March 2008
<b>Expires:</b> 2 March 2028	<b>Current Certification:</b> 1 February 2023

**Certificate No:** GCT20720



Calin Moldovean  
President, Business Assurance  
SAI Global Assurance



WWW.JAS-ANZ.ORG/REGISTER

This certificate remains the property of SAI Global and must be returned to SAI Global upon its request. Refer to [www.saiglobal.com](http://www.saiglobal.com), for the list of product models.



INFORM. INSPIRE. IMPROVE.

**AS2337 Cylinder Test Station Certificate**

**Expiry Date: 02 March 2028**

**SCHEDULE TO  
CERTIFICATE OF CONFORMITY**

SAI Global hereby grants:  
**Fire System Services**  
ABN47 635 264 476

100 South Terrace, Wingfield, SA 5013, Australia

**AS 2337 - Gas Cylinder Test Stations**

Nominated Signatory	Welded & Brazed AS 2337.1:2004	Seamless AS2337.1:2004	Automotive LPG AS2337.2:2004	Composite AS2337.3:2006	Automotive CNG AS2337.1:2004 and/or AS2337.3:2006	Acetylene Cylinders	Test Station Manager	Test Station Type	Date Endorsed
Joel Papamichael	Yes	Yes	Yes	Yes	No	No	No	Static	6 Mar 2013
Nick Papamichael	Yes	Yes	Yes	Yes	No		Yes	Static	27 Feb 2013

End of Record


**Certificate No:** GCT20720

**Issued Date:** 8 February 2023

This schedule supersedes all previously issued schedules

This certificate remains the property of SAI Global and must be returned to SAI Global upon its request. Refer to [www.saiglobal.com](http://www.saiglobal.com), for the list of product models.



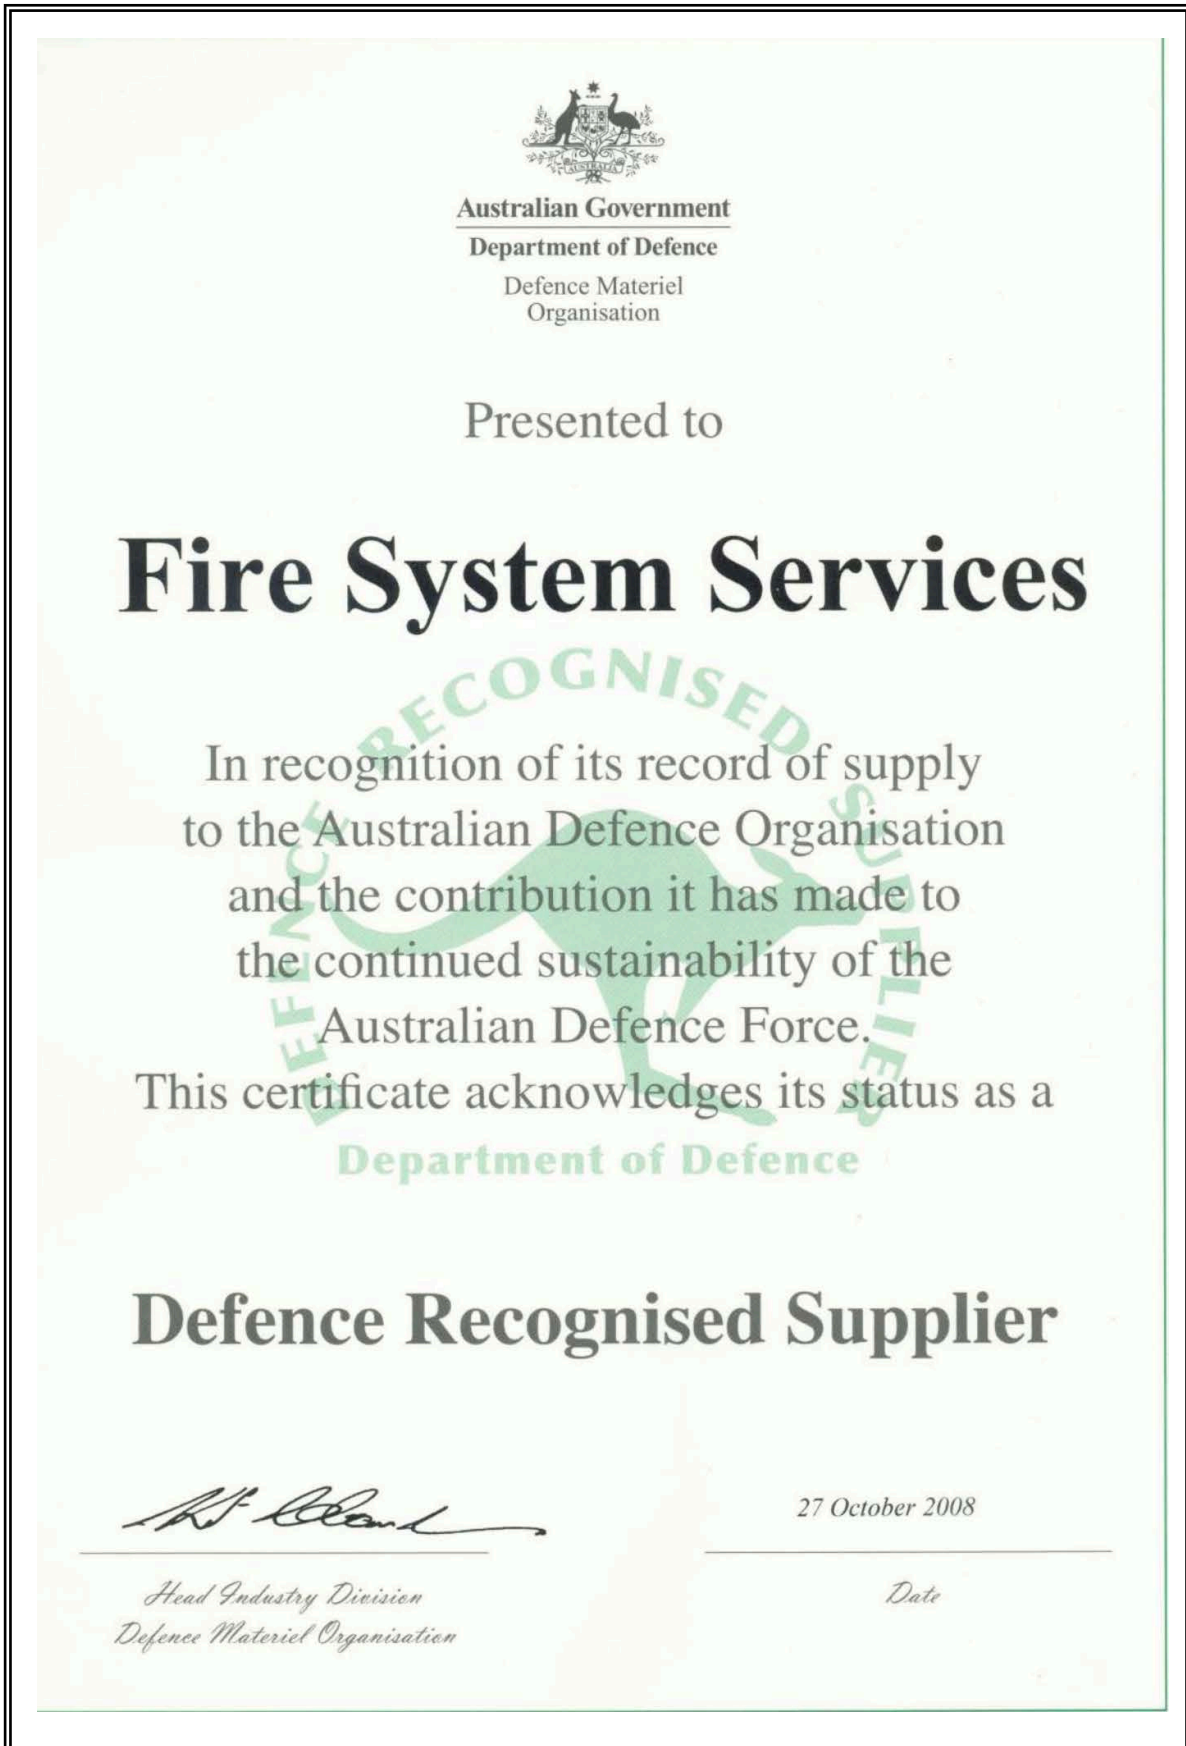

**NATO NCAGE**

**APPROVALS**



# Certificate

This is to certify that:

**FIRE SYSTEM SERVICES SA PTY LTD**

**located in:**

100 South Terrace  
Wingfield SA 5013

**ABN: 47-635-264-476**

**was given**

# ZOCU0

**NATO Commercial and Government Entity Code NCAGE**

Director  
Australian National Codification Bureau



Steve Bond  
17 December 2007



**DEFENCE MATERIEL ORGANISATION**

**FPAA FPAS**

**Expiry Date: May 2027**



**Fire Protection Association Australia**  
Congratulates

## **Fire System Services**

for successfully meeting the requirements  
of the Fire Protection Accreditation Scheme



### **Inspect and Test**

Exit and Emergency Lighting (C)  
Fire Detection and Alarm Systems (R)  
Fire Hydrant Systems (R)  
Portable Fire Extinguishers and Fire Hose Reels (C)

Business Recognition No. IT24585  
Valid to\* 30/05/2027

**Accreditation Team**  
Fire Protection Association Australia

\*Validity period is correct at time of issue.

[fpaa.com.au](http://fpaa.com.au)



**SAMFS FIRE PROTECTION CONTRACTOR**

**Expiry Date: N/A**


If calling please ask for:  
**Peter Spillane**

Telephone:  
8204 3611

Reference:  
Community Safety/16177/60091

12 November 2009

The Manager  
Fire System Services  
PO Box 16  
PROSPECT SA 5082

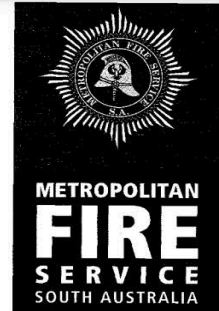

99 Wakefield Street  
Adelaide SA 5000  
GPO BOX 98  
Adelaide SA 5001  
Tel +61 8 8204 3600  
Fax +61 8 8204 3838  
www.samfs.sa.gov.au  
ABN 26 897 550 904

Dear Nick,

This Department acknowledges your correspondence regarding your application for recognition as a Fire Protection Contractor.

On the information presented, your company is accepted as an installer of thermal / smoke automatic fire alarms for connection to Fire Service equipment.

All fire detection and suppression components incorporated into any new or existing fire system connected to and monitored by the SAMFS must be listed in the CSIRO's ActivFire Scheme, Register of Fire Protection Equipment.

All systems are to be installed as per Australian Standard 1670, requirements of the current Building Regulations and any other relevant standards and/or codes.

The SAMFS Fire Safety Department reserves the right to seek confirmation of compliance with AS2118. from an independent organisation.

Please note that our copy of our 'Fire Alarm Conditions of Connection' which are to be complied with, can be down loaded from SAMFS's web site;

[www.samfs.sa.gov.au](http://www.samfs.sa.gov.au) / community policies/ commercial pages.

**JOSCAR - AU REGISTERED**

**Expiry Date: Sept 2026**



This is to certify that the holder of this certificate:

**FSS Fire System Services SA Pty Ltd**

Has satisfied all the requirements to become fully registered  
on the JOSCAR-AU supplier accreditation register, as set out  
by participating buying organisations.



**Colin Maund**  
CEO, Heliios Information

Renewal Date:

**06 September 2026**



JOSCAR-AU is supported by



**babcock**



**BAE SYSTEMS**



**BOEING**



**LOCKHEED MARTIN**  
AUSTRALIA



**Raytheon**  
Australia



**SAAB**

**FSS Sample Test Stations Release Certification**



Postal: PO Box 16, Prospect SA 5082  
 Site Address: 100 South Terrace, Wingfield SA 5013  
 Free Call: 1300 88 FIRE(3473) | Tel: 08 8445 6300 | Fax: 08 8445 6333  
 Email: info@firesys.com.au | Web: www.firesys.com.au



**720** **(NH) NATIONAL HYDRO CYLINDER TESTING SERVICES**

**Customer Details** Certificate No: **Sample**

Name:  Aircraft Registration:   
 Address:   
 Tel:

**Cylinder Details**

Date of Test:  Previous Test Date:  Retest Due Date:  Frequency Level:   
 Cylinder Manufacturer:  Date of Manufacture:  Serial Number:   
 Tare Weight:  kg Water Content:  litres Test Pressure:  MPa  
 Working Pressure:  -  Cylinder Gas Tariff:   
 Cylinder End Of Life:  Specification Number:  Ref:

**Test / Services Performed**

Test Length:  Reference Temperature:  Celsius  
 Visual Internal Exam:  Tare Weight Test:  Cylinder Internally Dried:   
 Visual Neck Thread Exam:  NDT Dye Penetrant Test:  Hydrostatic Pressure Test:   
 Visual External Exam:  NDT UT Eddy Current Test:  Proof Test:  Vol Expansion Test:   
 Cylinder Leak Test:  Cylinder Internally Washed:  Quality Assurance Data Log Test:

**Test Results**

Visual Internal Exam:	<input type="text"/>	Reason If Failed:	<input type="text"/>
Visual External Exam:	<input type="text"/>	Reason If Failed:	<input type="text"/>
Visual Neck Tread Exam:	<input type="text"/>	Reason If Failed:	<input type="text"/>
Hydrostatic Test:	<input type="text"/>	Reason If Failed:	<input type="text"/>
Tare Weight Test:	<input type="text"/>	Reason If Failed:	<input type="text"/>
NDT Dye Penetration Test:	<input type="text"/>	Reason If Failed:	<input type="text"/>
NDT UT Eddy Current Test:	<input type="text"/>	Reason If Failed:	<input type="text"/>
Cylinder Expan Ratio:	<input type="text"/>	Vol Permanent Expan:	<input type="text"/> mls
		Vol Total Expan Allowed:	<input type="text"/> mls

**Comments**

The above item of Pressure Equipment (PE) has been inspected with the requirements of AS2030 & AS2337 and was considered to be  as far as could be reasonably ascertained as at the time of inspection.

*This certificate is current from the date of inspection until operating conditions change or the next inspection is due, whichever occurs first.*

Technician Name:

Technician Signature:  Date:

**FSS Sample CASA Part 145 Release Certification**



Site Address: 100 South Terrace Wingfield SA 5013  
 Tel: 1300 88 FIRE (3473)  
 Email: info@firesys.com.au | Web: www.firesys.com.au



SAI GLOBAL  
 AS2337  
 Gas Cylinder  
 Test Station  
 No: 720

**720**  **National Hydro Cylinder Testing Services**


Customer	Sample Data Log Certificate
Certificate of Test No	1
Job Reference	Sample Test
Serial No	1


All testing is in accordance with AS2030 & AS2337

**Data Collection Report Certificate**

Gauge Information	
Serial Number	357399
Model	WT10KPSI
Message Store	Cal: 11/2016
Units	bar

Run Info	
Start Time	9/2/17 10:01:44 AM
Stop Time	9/2/17 10:46:27 AM
Logging Interval	10

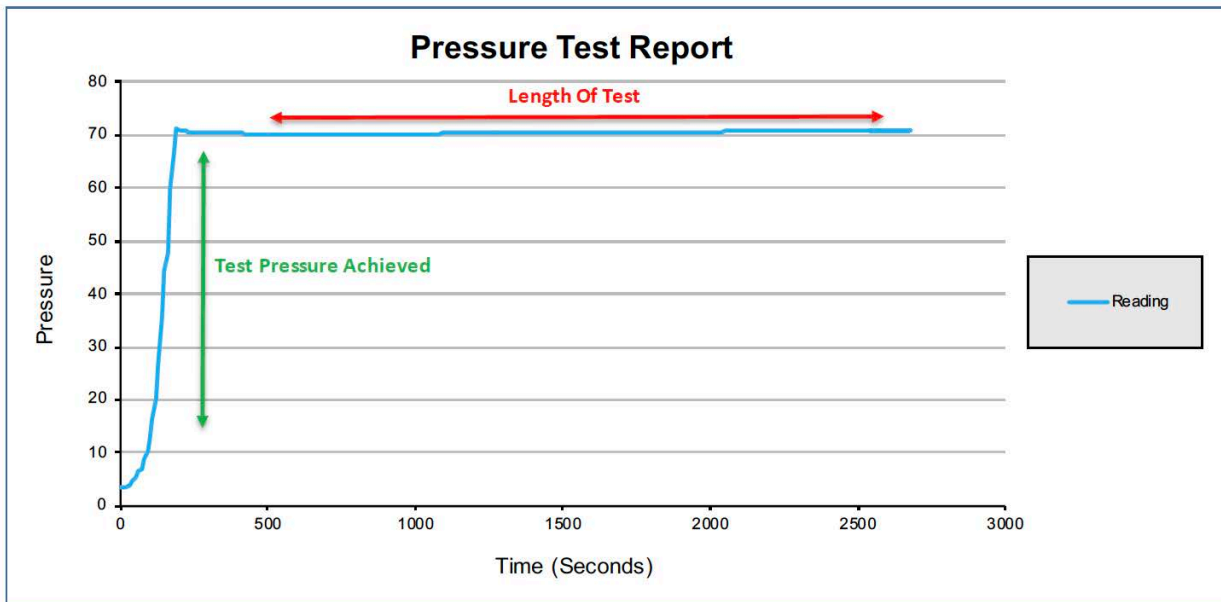

  
 signed by Test Station Manager

**FSS Extinguisher Agent Trading Authorisation Certification**

**Expiry Date: August 2027**


# EXTINGUISHING AGENT TRADING AUTHORISATION

**CERTIFICATE NUMBER: EATA15409  
EXPIRES ON: 06/08/2027**

The Fire Protection Industry (ODS & SGG) Board  
hereby certifies that

## Fire System Services

is approved - in accordance with the provisions of the Ozone Protection and Synthetic Greenhouse Gas Management Regulations 1995 - for the period between **06 August 2024** and **06 August 2027**, to acquire, store or dispose of \*extinguishing agents that are for use in, or have been used in, fire protection equipment for the purpose as stated in the application.

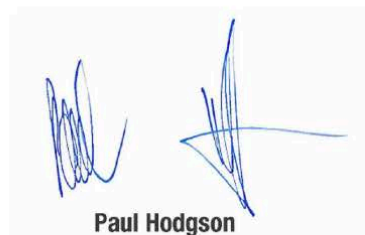

**Paul Hodgson**  
Executive Officer  
Ozone Protection



**FIRE PROTECTION  
INDUSTRY (ODS & SGG)  
BOARD**

Building 2, 31-47 Joseph Street  
Blackburn North VIC 3130  
PO Box 1049 Box Hill VIC 3128

T 03 8892 3131 F 03 8892 3132  
E ozone@fpib.com.au  
E www.fpib.com.au

---

**Intentionally Left Blank**